



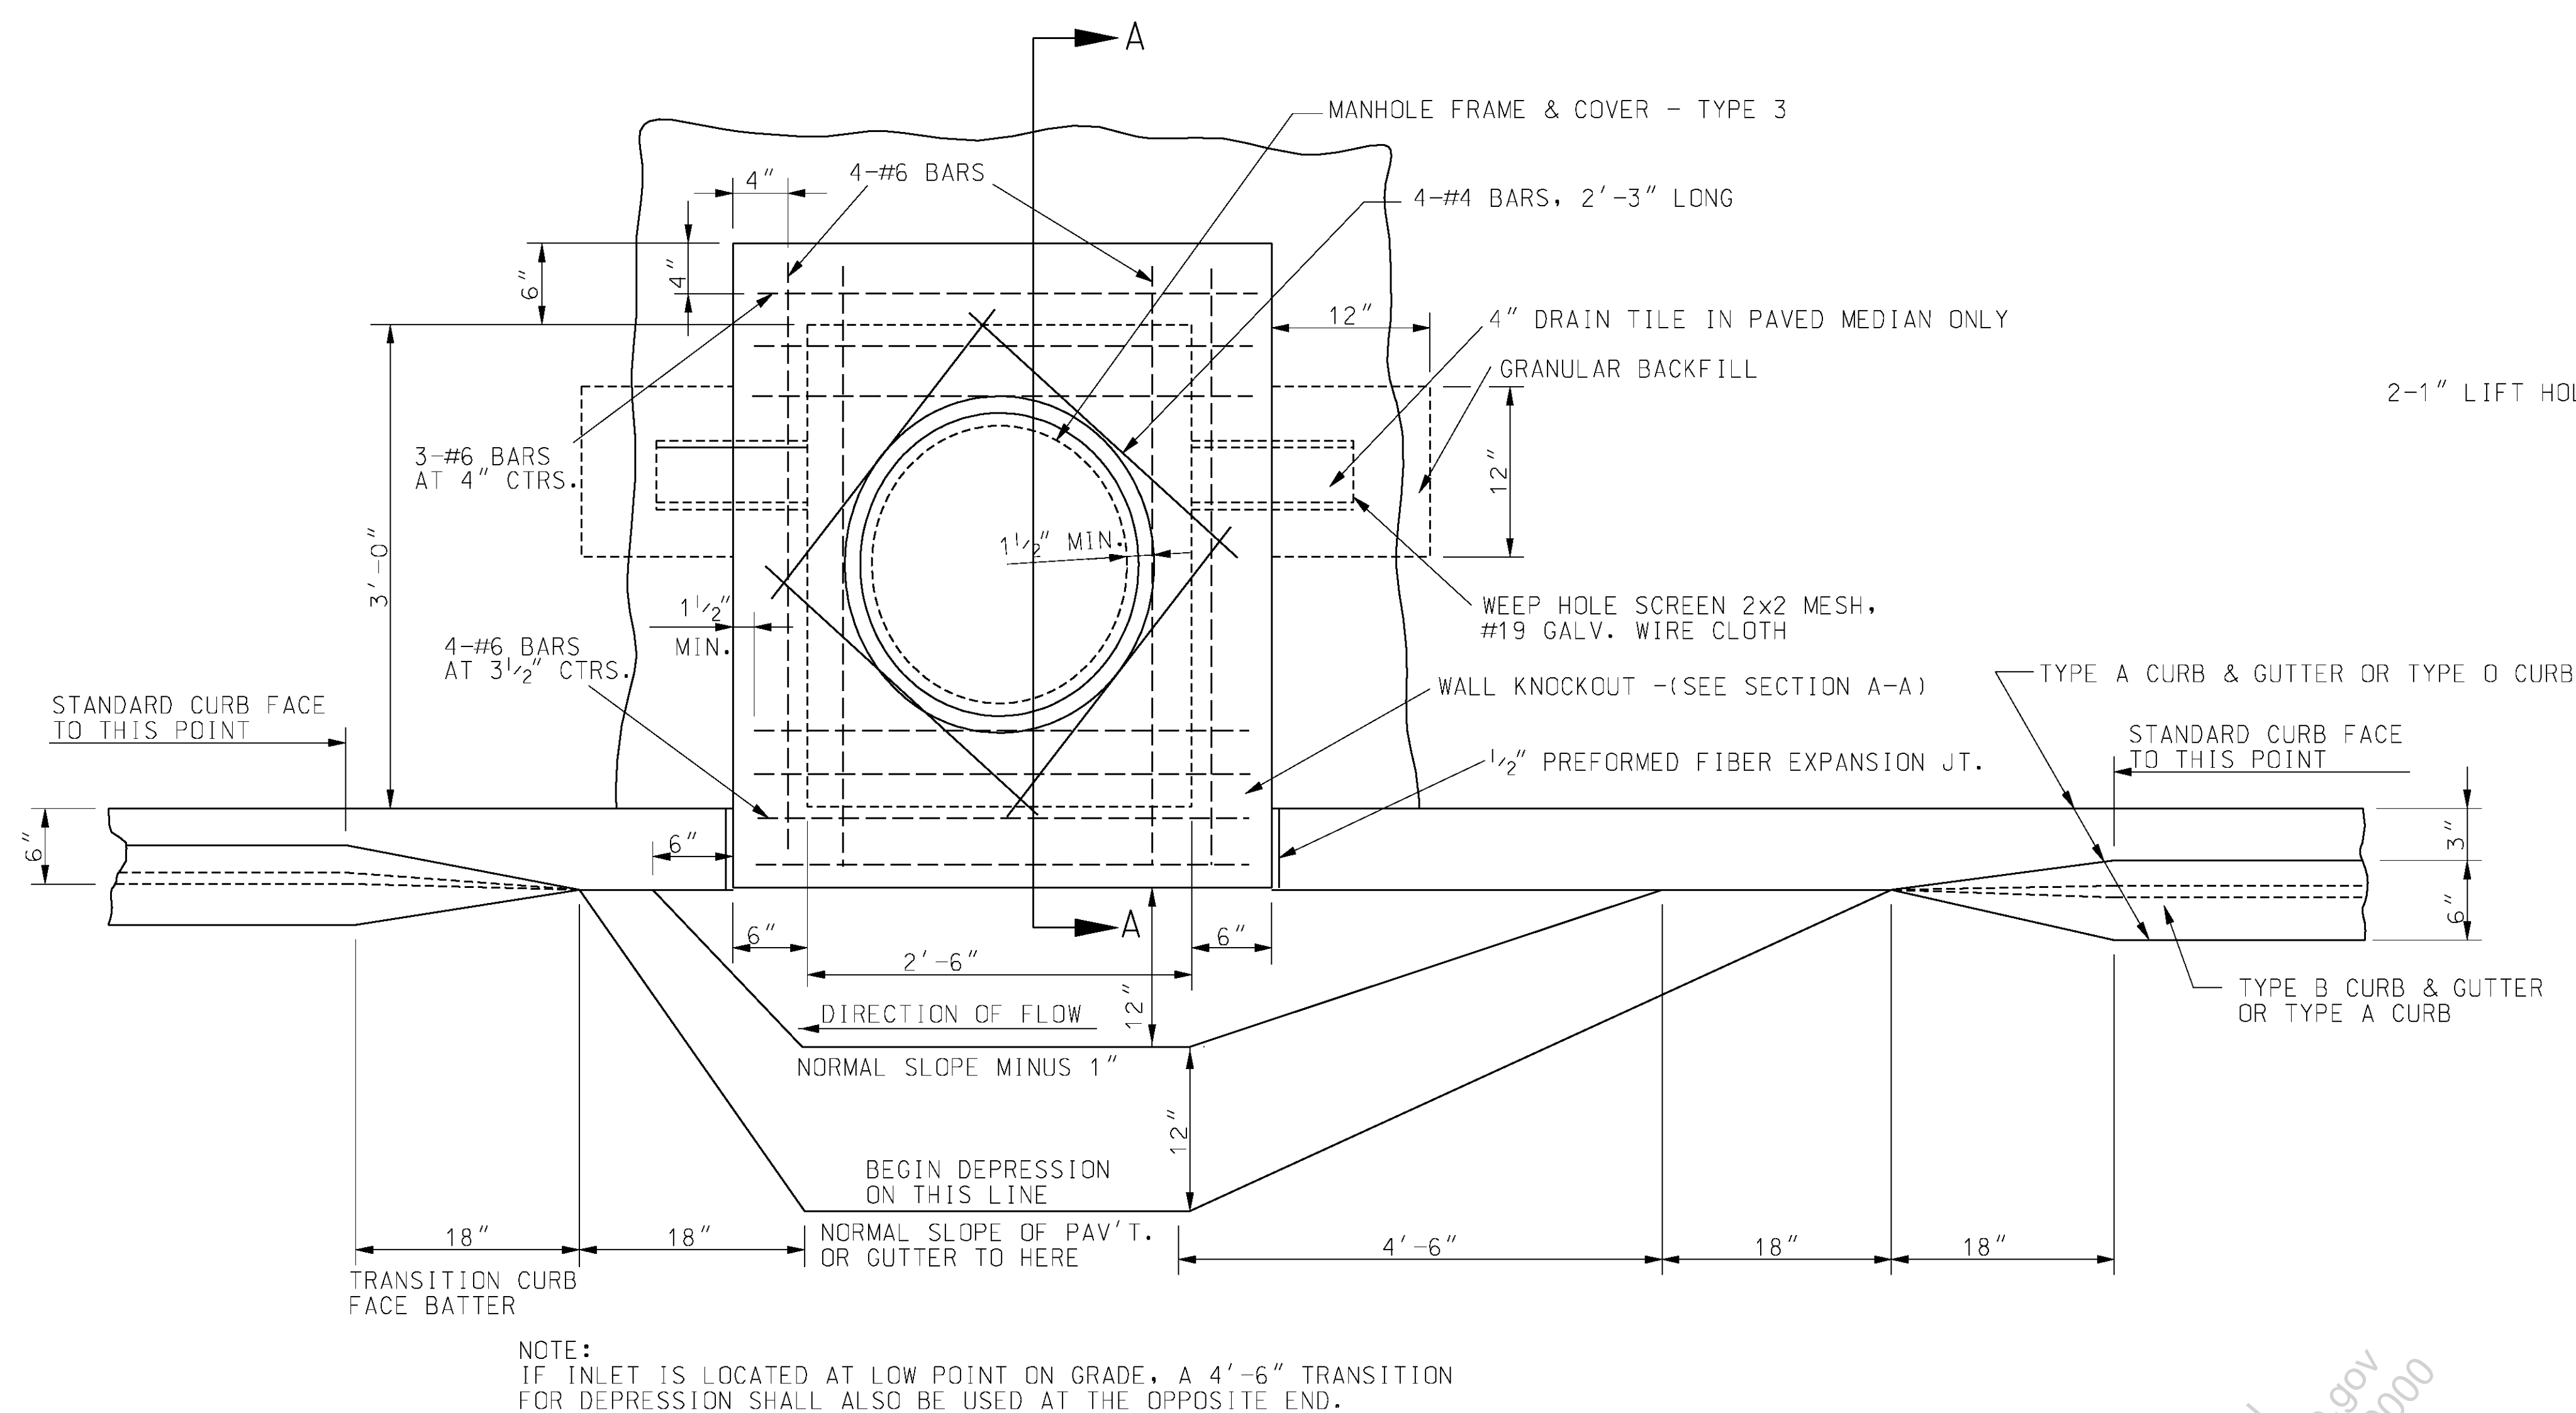


PLAN

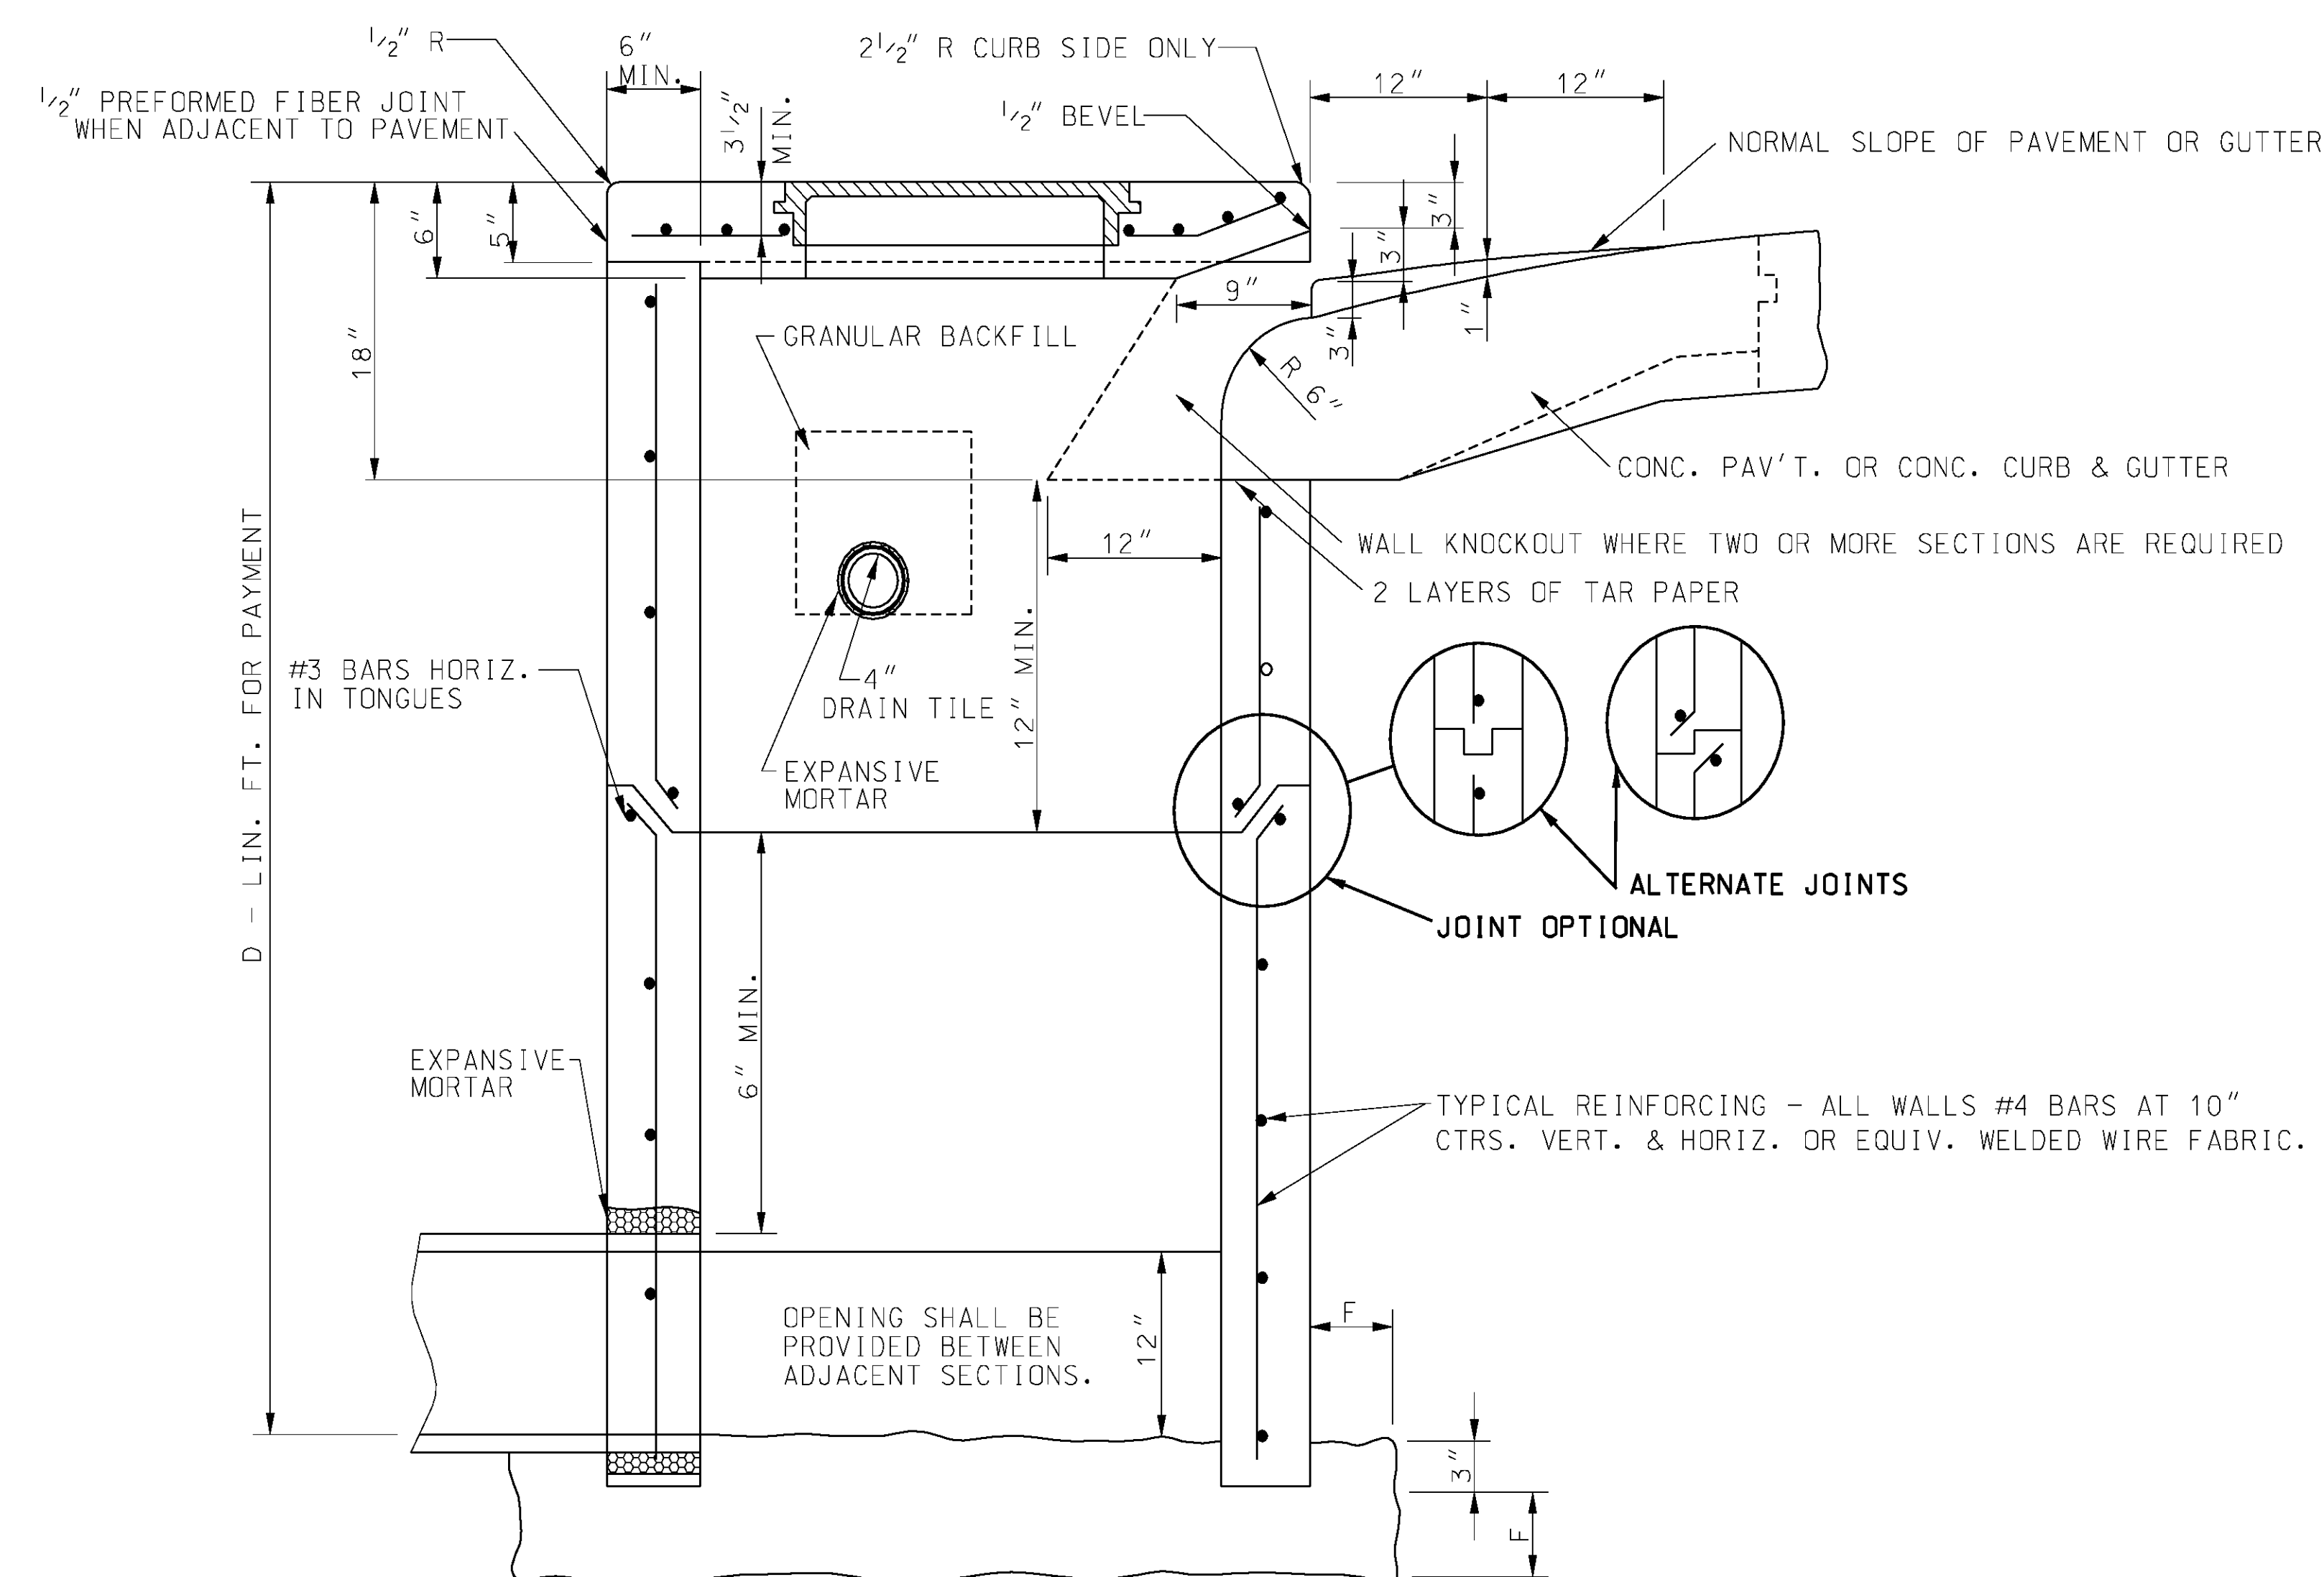


PRECAST BASE SECTION SET ON CONCRETE BLOCKS
FOUNDATION SLAB AND INVERT POURED MONOLITHIC.

SEE SHEET ONE (1) FOR DETAILS ON
OPTIONAL PRECAST FOUNDATION SLAB.


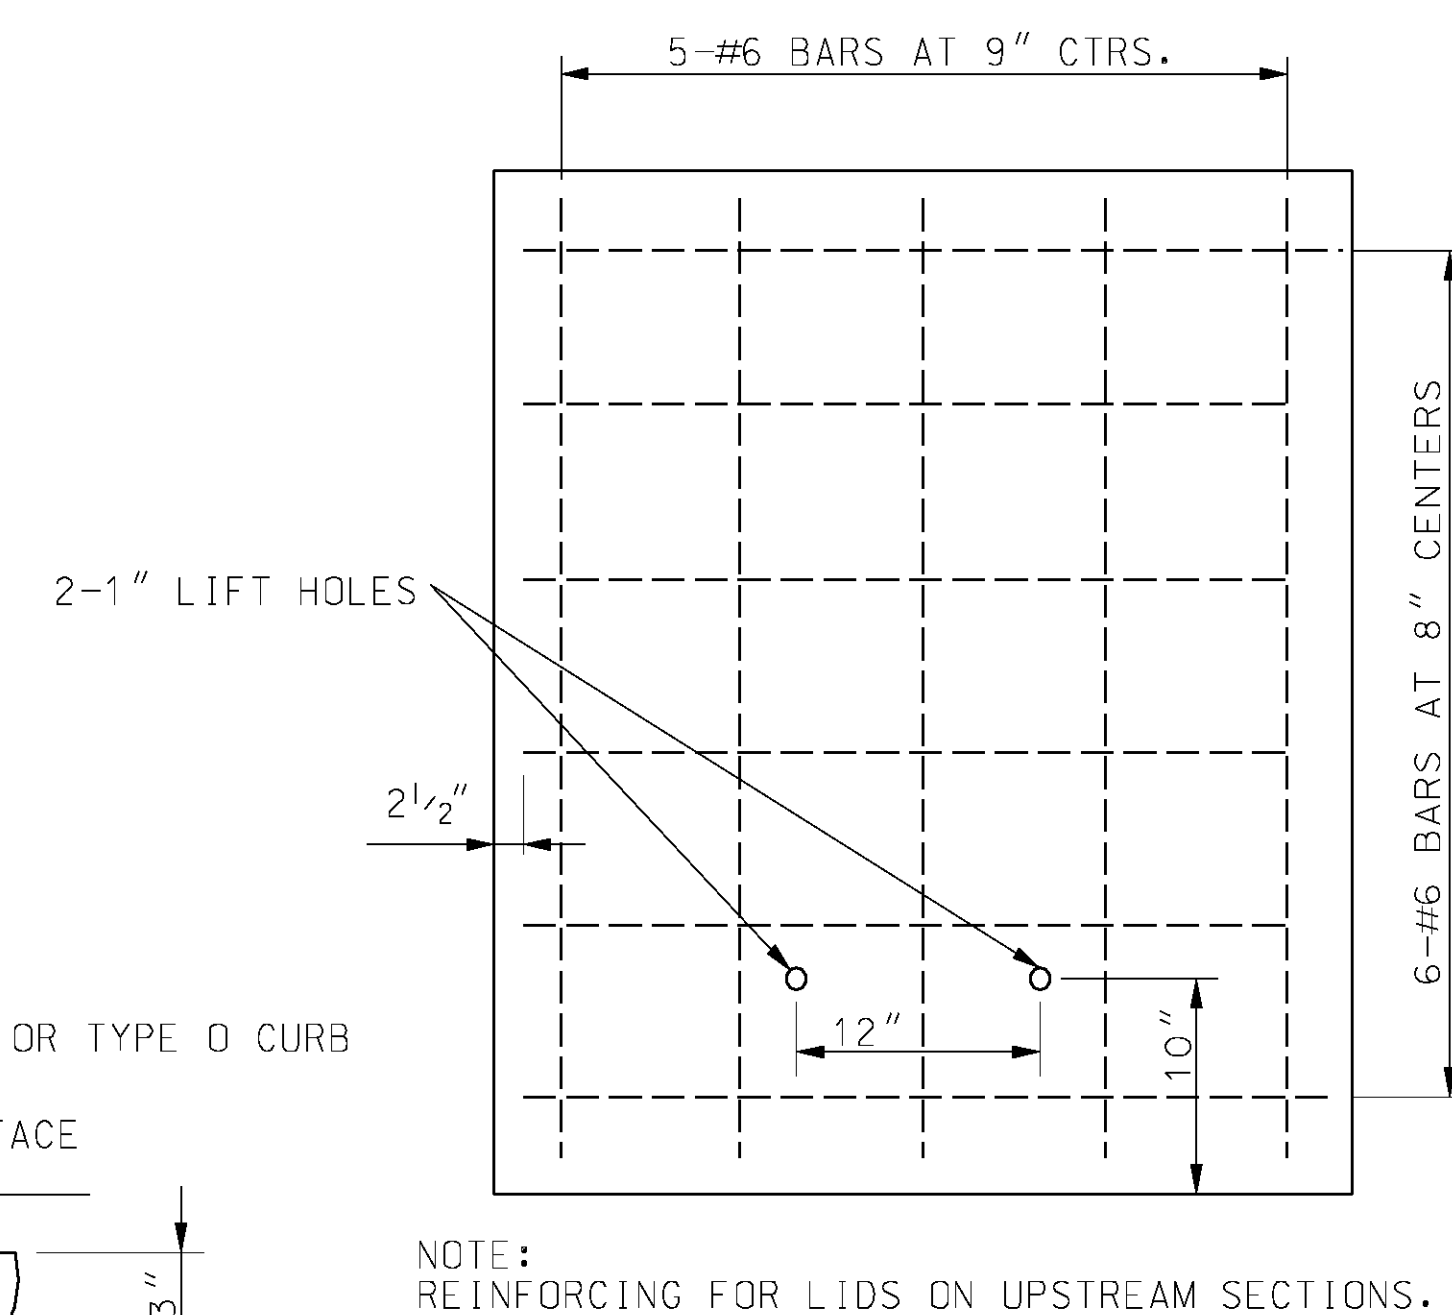


LID FOR ADJACENT
SECTIONS

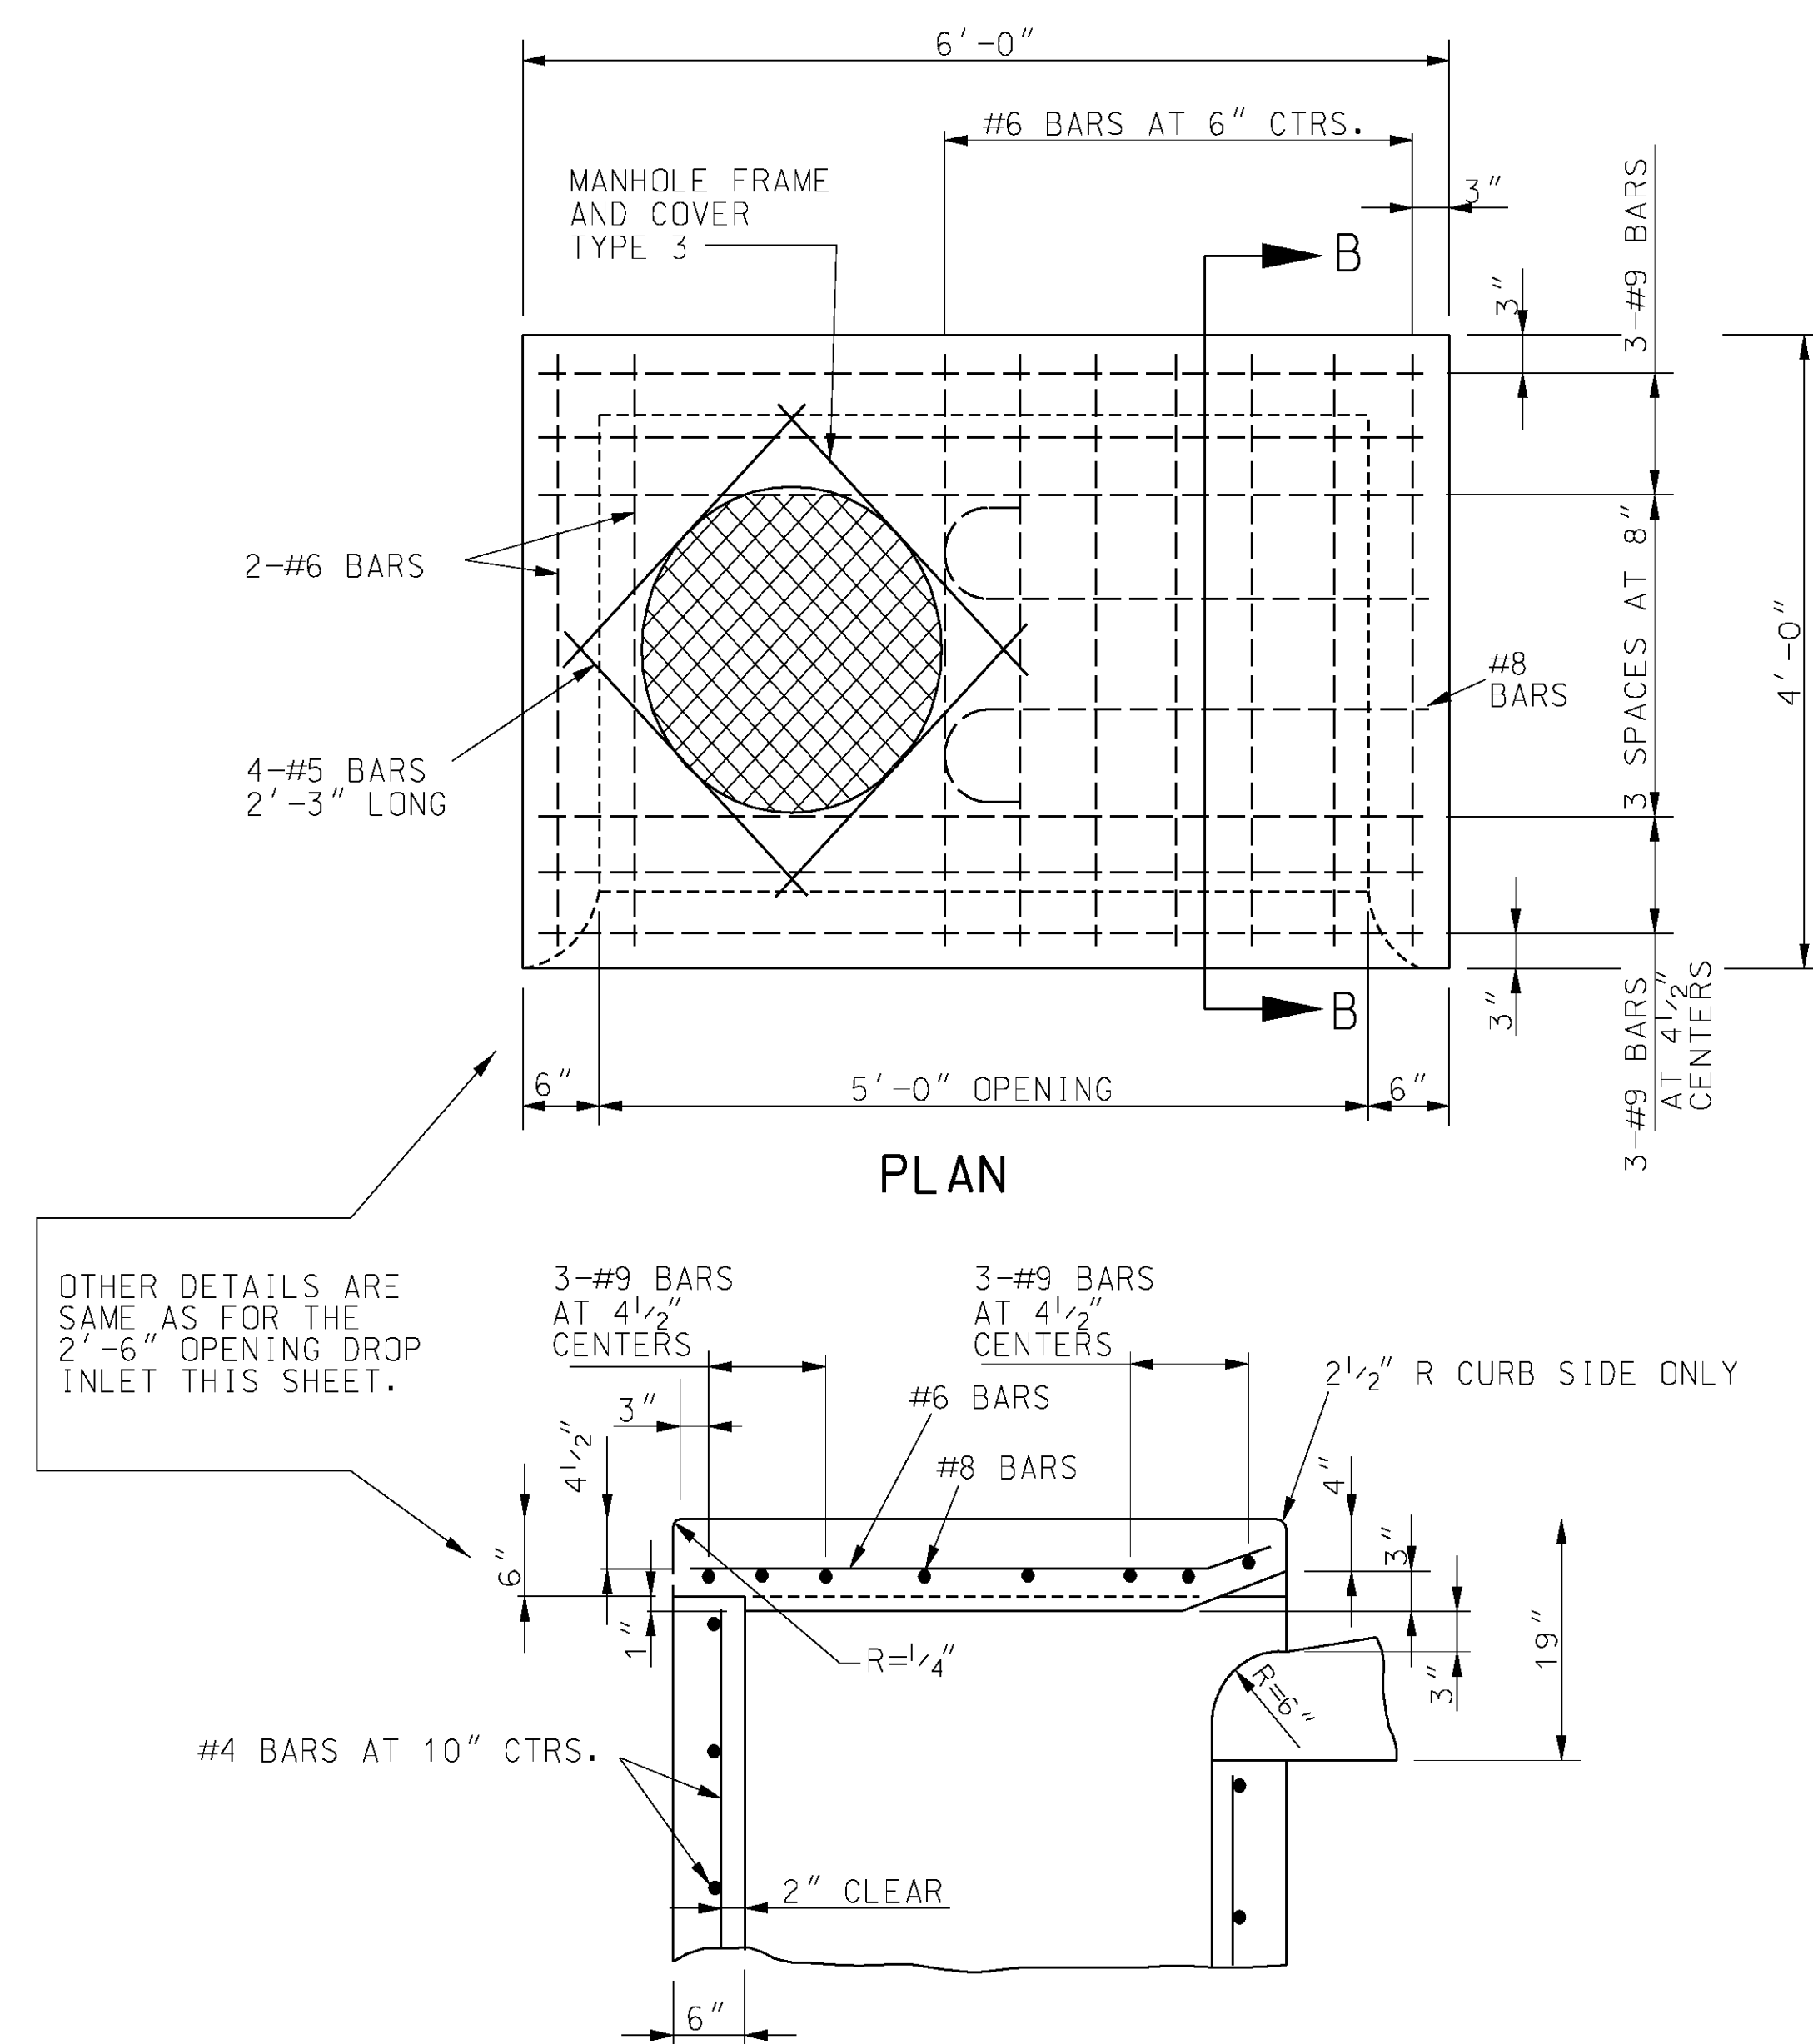

SECTION B-B

OPTIONAL PRECAST CURB INLET
5'-0" OPENING

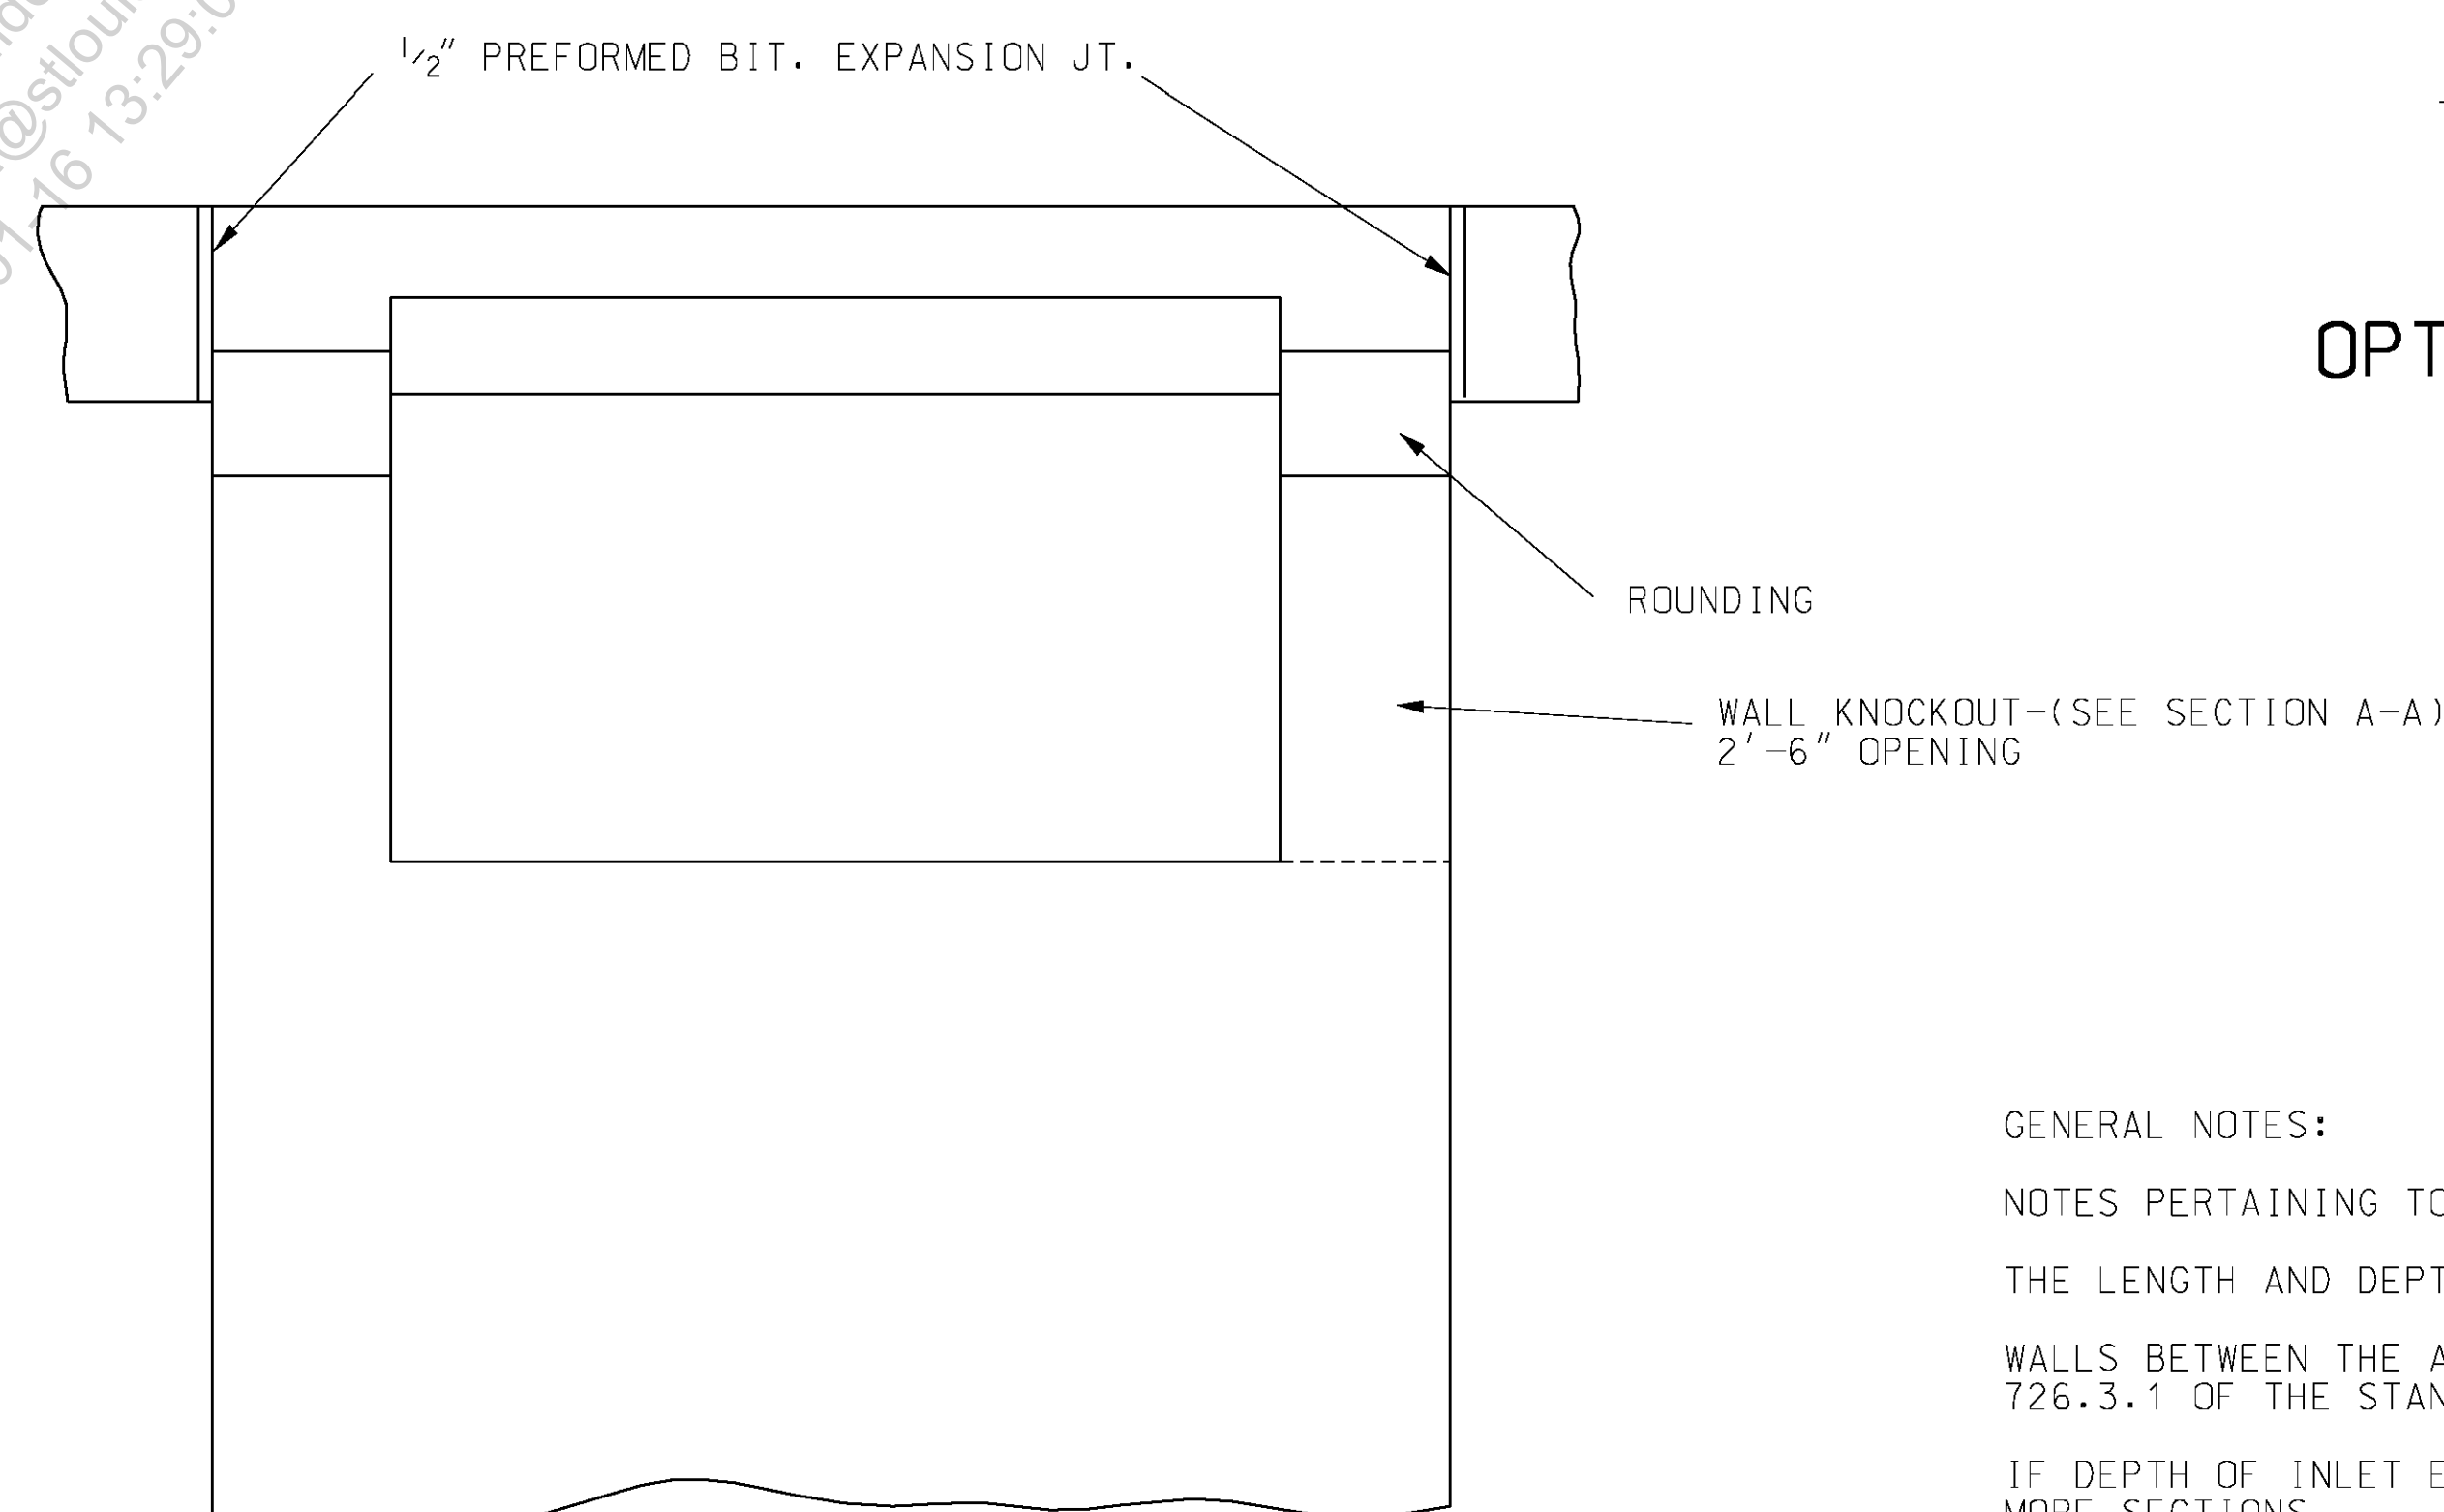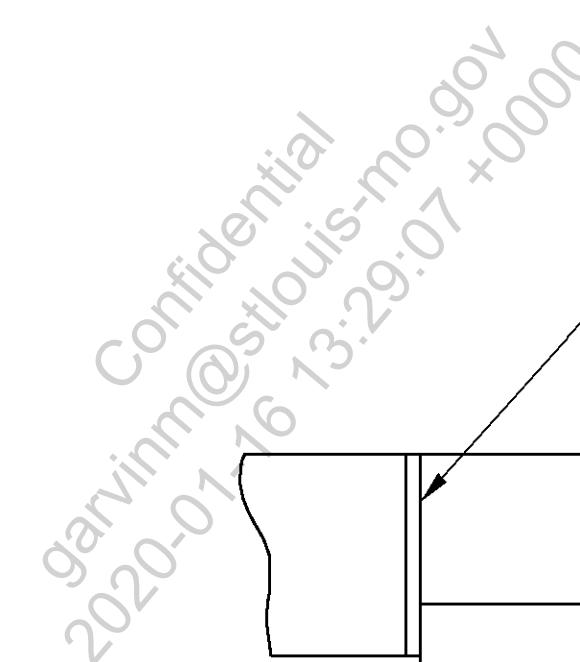

— WALL KNOCKOUT—(SEE SECTION A-A)
2'-6" OPENING

DETAILS OF OPENING

GENERAL NOTES:

NOTES PERTAINING TO TYPE "T":

THE LENGTH AND DEPTH OF THE INLET SHALL BE AS SHOWN ON THE PLANS.

WALLS BETWEEN THE ADJACENT SECTIONS SHALL BE SEALED IN ACCORDANCE WITH SECTION 726.3.1 OF THE STANDARD SPECIFICATIONS.

IF DEPTH OF INLET EXCEEDS 6 FEET THE PRECAST UNITS MAY BE FURNISHED IN TWO OR MORE SECTIONS.

IF TWO OR MORE SECTIONS ARE USED THE TYPE 3 MANHOLE FRAME AND COVER SHALL BE IN THE DOWNSTREAM SECTION ONLY.

IF A 5 FOOT OPENING IS REQUIRED, TWO 2'-6" OPENING SECTION OR ONE 5 FOOT OPENING SECTION MAY BE PROVIDED AT THE CONTRACTOR'S OPTION.

SEE SHEET 1 FOR STEP DETAILS AND SHEET 2 FOR GENERAL NOTES.

	PRECAST DROP INLET CURB INLET - TYPE T		
DATE: _____	EFFECTIVE: 01-01-2002	731.10P	3 4